

Model UV40

Deodorize and Sanitize with the Power of Activated Oxygen

After Drying

- Post warning signs Ozone in Use
- Sanitize area using activated oxygen by running the ozone for a period of time as specified on the Ozone Calc
- 1 hour 3,600 CF
- 2 hours 7,200 CF




After a Fire

- After source removal
- Post warning signs “Ozone in Use”
- Place area under positive pressure
- Place small fans for every 150 SF
- Deodorize area using activated oxygen by running the ozone for a period of time as specified on the Ozone Calc App
- To Purge put on respirator with organic cartridge prior to entry
- Purge the area



Industrial Unit

- Proprietary UV Ozone Bulbs
- High output UV Ozone 40 GPH
- No Nitric Oxide production
- Stainless Steel Construction
- UV Bulbs last 10,000 Hours
- Minimal Maintenance
- Versatility for odor and sanitizing
- 300 CFM fan
- Download Ozone Calc App

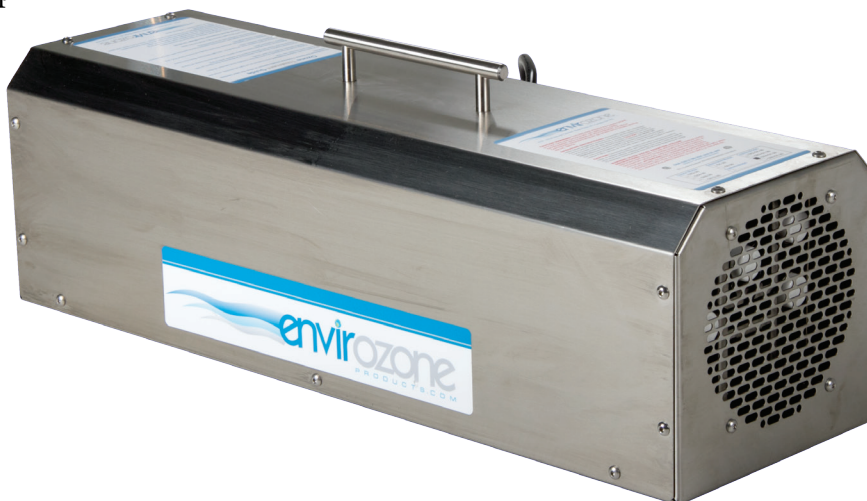

Application	Treatment Volume	Germicidal Function	Ozone- Activated Oxygen Function
Water Damage	Up to 1,800 CF	After Drying Phase	Use Ozone Calc – run 45m purge 15m
Smoke/Odor	UP to 24,000 CF		Use Ozone Calc – run 4h – purge 1h
Flood Stabilization	Up to 12,000 CF	During process	Use Ozone Calc – run 4h – don't purge

Envirozone Product models are industrial ozone generators, designed to be used in unoccupied areas or in volumes limited by OSHA regulations.